



- NOTES
1. MANHOLE SHALL BE CONSTRUCTED IN ACCORDANCE WITH CITY STANDARD DRAWING S-3 & S-4.
 2. USE OF DROP MANHOLES SHALL BE DISCOURAGED AND ALLOWED ONLY UPON SPECIAL AUTHORIZATION OF THE CITY ENGINEER BASED UPON THE FOLLOWING CRITERIA:
 - A. USED FOR 6" AND 8" DIA. LATERAL LINES ONLY
 - B. WHEN DESIGN VELOCITIES WILL EXCEED 7.5 FPS
 - C. WHENEVER THE DIFFERENCE BETWEEN THE SOFFIT OF THE MAIN LINE AND THE SOFFIT OF THE LATERAL LINE IS TWO FEET OR GREATER

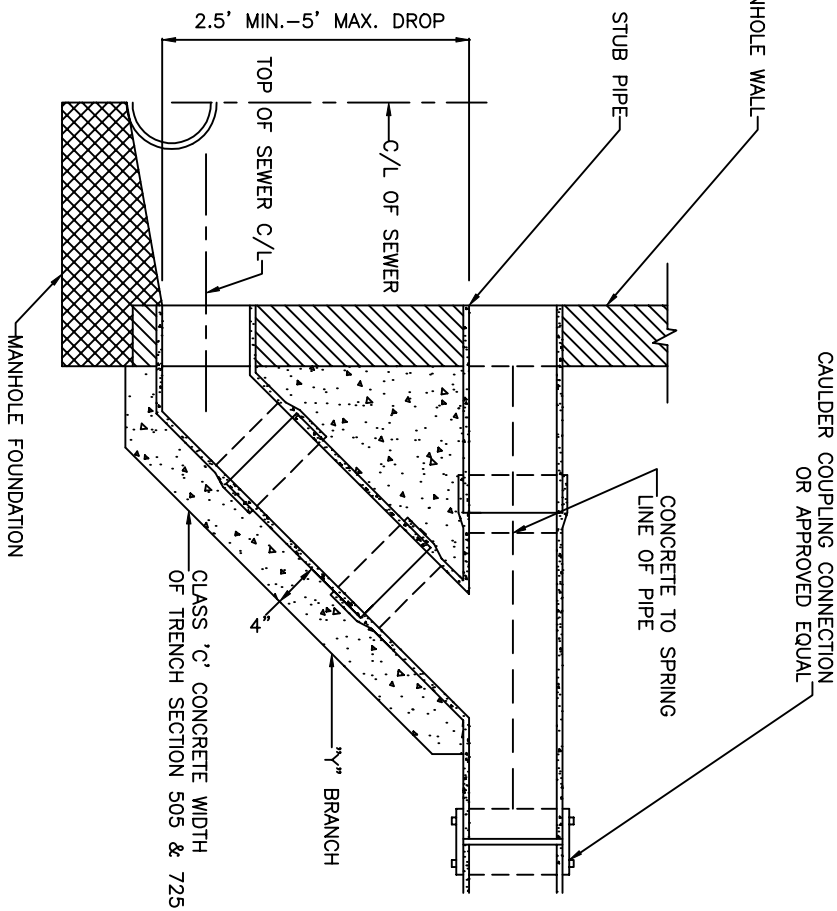

TYPE A
2.5' TO 5' DROP

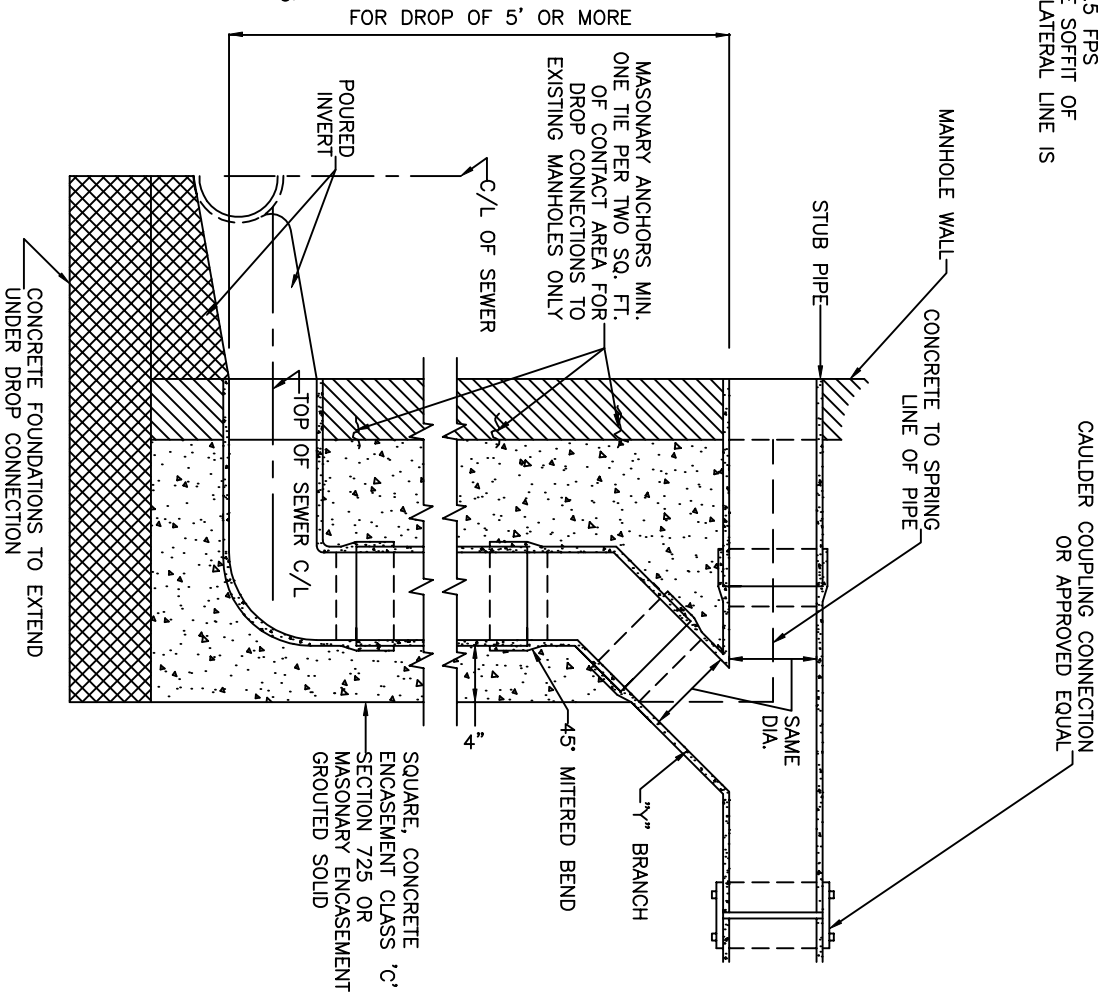

TYPE B
5' OR MORE

DROP SEWER MAIN CONNECTIONS (6" AND 8" ONLY)

REF. & REV.
AUG. 2002

CITY OF FRESNO
S-11